SSO, Event Details Page 1 of 3



Clean Water Information System

Event Search

- Account Settings
- More Information
- Logout

Overflow / Bypass Event Details

Initial Report

Facility Name:	Bolivar WWTF
Permit No:	MO0022373


Once you enter the Event End Date & Time fields and Add Event/Save Changes, you will no longer be able to edit this record!

Event Details				
	Bypass = at the wastewater treatment plant; Overflow = in the collection system			
Confirmation No:	5929			
*Type of Event:	SSO (Overflow) 🗸			
*Wet or Dry Event?	Dry ✓			
*Event Begin Date:	03/20/2015 (MM/DD/YYYY)			
*Event Begin Time:	14:55 (HH:MM) Military Time			
**Event End Date:	03/20/2015 (MM/DD/YYYY)			
**Event End Time:	15:55 (HH:MM) Military Time			
Event Duration (hh:mm)	0d:1h:0m:			
*Initial Report Date:	03/23/2015 (MM/DD/YYYY)			
*Initial Report Time:	07:36 (HH:MM) Military Time			
Discharged To:	Stormsewer			
*Reported By:	Bob Allard			
*Immediate Contact	(417) 399 - 3555			
Ongoing?:				
*Estimated Volume at time of Initial Report (gallons):	300.00			
Is bypass/overflow reaching Waters of the State?				

^{*} Indicates a Required Field

^{**}Indicates a Required Field for Final Report

SSO, Event Details Page 2 of 3

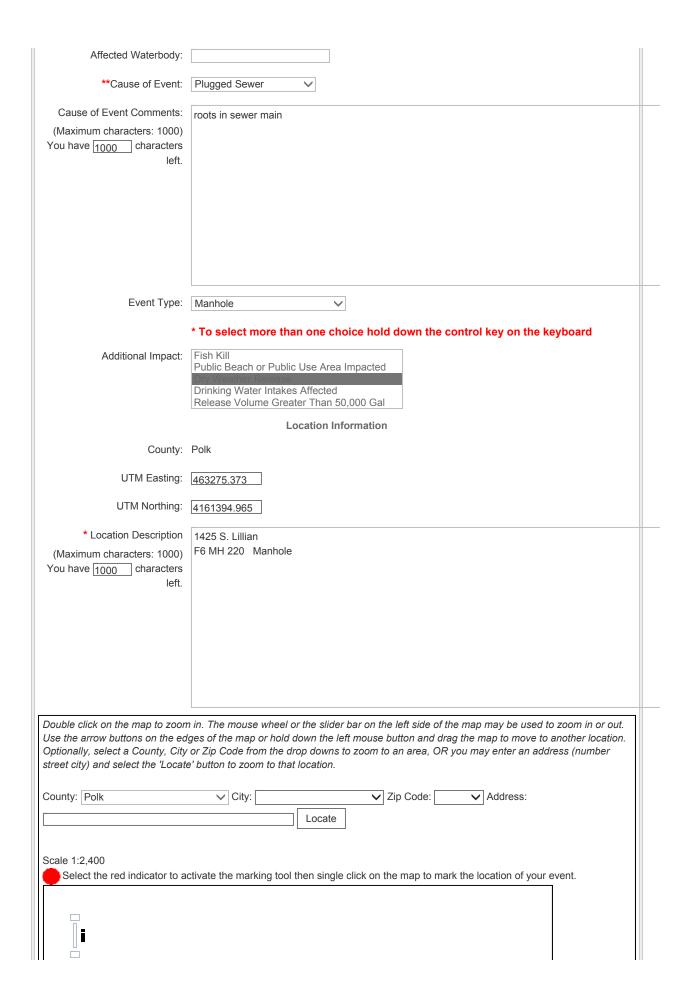

SSO, Event Details Page 3 of 3

	5 - Day Report	-
Estimated Final Total Volume (gallons): Did bypass reach Waters of the State?	300.00	
**Response: (Maximum characters: 1000) You have 1000 characters left.	After receiving phone call in regards to sewer problem. Crew jetted sewer main and opened the plugged sewer main.	
Record added by:	nr.bradj Add Additional Event	

Department of Natural Resources 1-800-361-4827 / 573-751-1300 E-mail: cleanwater@dnr.mo.gov P.O. Box 176, Jefferson City, MO 65102